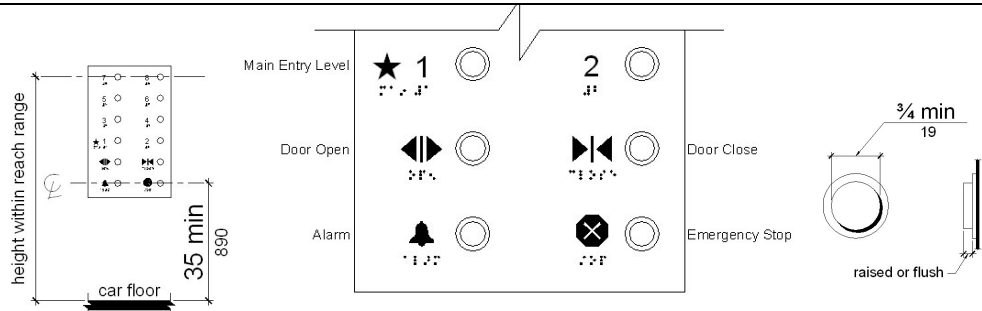


| ELEMENT | COMPLIES (or NA) | DOES NOT COMPLY |
|---------|---------------------|--------------------|
|---------|---------------------|--------------------|

| | | |
|------------------|--|--|
| ELEVATORS | | |
|------------------|--|--|

| | | | |
|----------------|---|--|--|
| WHERE REQUIRED | <p>One passenger elevator complying with this section shall serve each level of all multi-story buildings.</p> <p>Exceptions:</p> <ol style="list-style-type: none"> 1. Not required in buildings less than 3 stories or less than 3,000 SF unless the building is a shopping center, office of a professional health care provider or a public transportation stop. 2. Elevator pits, elevator penthouses, or mechanical rooms are exempt. 3. Ramps or platform lifts may be used in lieu of an elevator. <p>A freight elevator shall be consider as meeting the requirements of this section unless it is the only elevator provided and it is used as a combination passenger and freight elevator.</p> | | |
|----------------|---|--|--|

| | | | |
|------------|---|--------------------------|--------------------------|
| ELEVATOR | <p>Operation (automatic, self-leveling cab to within 1/2" of floor level)</p> <p>Hall call button (42" AFF; visual signal to indicate call placed; min. 3/4" dia.; flush or raised)</p> <p>Hall lantern (visible; min. 72" AFF; min. 2 1/2" size; audible – sounds once for "up", twice for "down")</p> | <input type="checkbox"/> | <input type="checkbox"/> |
| Controls | | | |
| | <p>Hoistway characters (both jambs; 60" AFF; 2" high, raised 1/32", upper case, with Braille)</p> <p>Door opening device (door stop & reopen if obstructed between 5"-29" AFF; effective for 20 sec.)</p> <p>Door delay (shall remain fully open for min. 3 sec.)</p> <p>Door (36" min. clear opening, max. 1 1/4" clear space between landing and car platform)</p> <p>Floor plan (ability to enter, use controls and exit; acceptable dimensions illustrated below)</p> | <input type="checkbox"/> | <input type="checkbox"/> |
| Floor plan | | | |
| | <p>Floor surface (firm, stable, slip-resistant; carpet if provided, 1/2" max. pile, securely attached)</p> <p>Illumination (min. 5 foot-candles)</p> | <input type="checkbox"/> | <input type="checkbox"/> |
| CONTROLS | <p>Car control buttons (min. 3/4" dia.; flush or raised)</p> <p>Car control indicators (include Braille & character, left of button; 5/8"-2" high; w/visual signal; "star" to indicate main entry level)</p> | <input type="checkbox"/> | <input type="checkbox"/> |

| ELEMENT | COMPLIES (or NA) | DOES NOT COMPLY |
|---|--------------------------|--------------------------|
| <p>Controls</p>  | | |
| <p>Emergency Communications (shall not be voice-only)</p> | <input type="checkbox"/> | <input type="checkbox"/> |
| <p>Emergency Controls (max. 48" AFF; identified with Braille & character; door to controls operable without tight pinching, twisting or turning of the wrist)</p> | <input type="checkbox"/> | <input type="checkbox"/> |